



連接多項裝置

Connect With Several Detector Devices

操作設定簡易

Easy To Set-Up & Operate

集中管理監控

Central Management And Control

遠端連線控制

Network Connecting Control

讓災害防範於未然 Prevent disasters before they happen

瓦斯洩漏遮斷操作系統

Gas Leakage Intercept Operating System

前瞻

ADVANCED

創新


INNOVATION

人性化

USERS FRIENDLY

功能示意圖

Functional Schematic Diagram

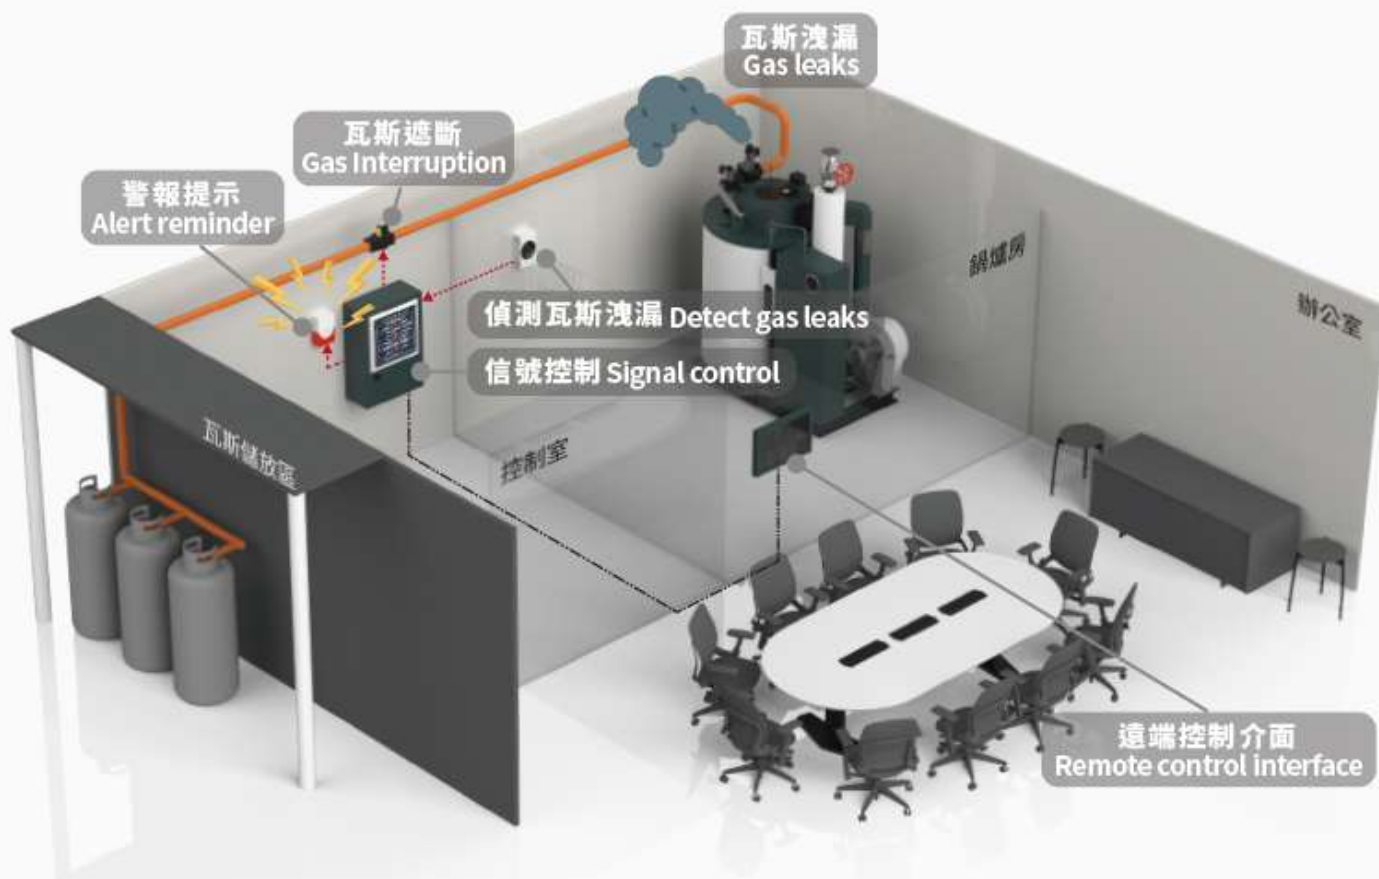

遮斷閥是一種用於瓦斯輸配系統，避免地震，超壓（高/低）緊急遮斷瓦斯供應的安全裝置。當系統中的任何異常引起監控壓力達到預定警戒值時該裝置迅速自動截斷瓦斯，也可手動操縱該裝置截斷瓦斯供給。

The shutoff valve is a safety device used in the gas transmission and distribution system to avoid earthquakes and overpressure (high/low) to urgently shut off the gas supply. When any abnormality in the system causes the monitoring pressure to reach a predetermined warning value, the device quickly and automatically cuts off the gas, or it can be manually operated to cut off the gas supply.

瓦斯漏氣由感知器感應
The gas leak is sensed by the sensor.



立即將信號送至控制箱
Send the signal to the control box immediately.



控制箱接收感知器信號
The control box receives the sensor signal.



遮斷閥遮斷瓦斯管路
The shutoff valve shuts off the gas pipeline.



控制箱傳送信號給警報器
The control box sends a signal to the alarm.



警報器警告相關人員注意
The siren warns relevant personnel to pay attention.

可連接多項檢測裝置

Connect With Several Detector Devices



瓦斯洩漏 Gas leak



瓦斯漏氣感知器(吸頂式)
Gas Leak Detector(Ceiling type)



瓦斯漏氣感知器(壁掛式)
Gas Leak Detector(Wall type)

具備先進科技微電腦處理器及智慧型控制，隨時進行多項智慧型監測及控制。大幅降低瓦斯中毒及瓦斯爆炸發生機率。

With advanced technology microcomputer processor and Intelligent control, It can carry out multiple Intelligent monitoring and control at any time. Significantly reduce the probability of gas poisoning and gas explosion.



一氧化碳 CO leak



一氧化碳感知器(吸頂式)
CO Detector(Ceiling type)



一氧化碳感知器(壁掛式)
CO Detector(Wall type)

具備先進科技微電腦處理器以及智慧型控制，隨時進行多項智慧型監測及控制，並且隨時對一氧化碳等氣體的濃度變化及經過時間進行精確的運算。

With advanced technology microcomputer processor and Intelligent control, It can carry out multiple Intelligent monitoring and control at any time, and accurately calculate the concentration changes and elapsed time of carbon monoxide and other gases at any time.



火災 fire



煙霧感知器
Smoke Detector

採用光電式偵測原理，不含離子放射性物質，符合環保，確保安全。能早期偵測悶燒，早先預防火警。

It adopts the photoelectric detection principle, does not contain ionic radioactive substances, is environmentally friendly and ensures safety. It can detect smoldering early and prevent fire early.



地震 earthquake



地震感知器
Earthquake Sensor

當發生超過設定值以上的地震時，使瓦斯等危險氣體遮斷供給。

When an earthquake that exceeds the set value occurs, the supply of dangerous gas such as gas will be interrupted.

適用場所 Applicable Field





服務團隊 SERVICE TEAM

本公司是專業的鍋爐製造廠，如有任何需求歡迎與我們聯絡。
ZU HOW INDUSTRY IS A PROFESSIONAL BOILER MANUFACTURER.
PLEASE DO NOT HESITATE TO CONTACT US WITH ANY INQUIRY.

雲林總公司 YUNLIN HEAD OFFICE

雲林縣虎尾鎮頂溪里崁腳30號

 No.30 Kanjiao,Dingxi Village,Huwei Township,Yunlin County,63250 Taiwan.


 +886-5-622-3611  zuhow@ms32.hinet.net

 +886-5-622-3077  www.zuhow.com.tw
www.zuhow-boiler.com

台北分公司 TAIPEI BRANCH

新北市土城區 Tucheng District,New Taipei City

 +886-2-2268-6566

 +886-2-2269-3339

台中分公司 TAICHUNG BRANCH

台中市霧峰區 Wufeng District,Taichung City

 +886-4-2332-3111

 +886-4-2331-1122

台南分公司 TAINAN BRANCH

台南市新化區 Xinhua District,Tainan City

 +886-6-598-4525

 +886-6-598-2425

台東分公司 TAITUNG BRANCH


台東縣台東市 Taitung City,Taitung County

 +886-89-385-168

 +886-89-385-169

河內分公司 HANOI BRANCH

河內市福壽縣 Fushou County,Hanoi City

 +84-9381-44717

 +84-2432-047566

苗栗分公司 MIAOLI BRANCH

苗栗縣頭份市 Toufen City,Miaoli County

 +886-37-676-123

 +886-37-676-790

嘉義分公司 CHIAYI BRANCH

嘉義縣中埔鄉 Zhongpu Township,Chiayi County

 +886-5-239-1515

 +886-5-230-7575

高雄分公司 KAOHSIUNG BRANCH

高雄市仁武區 Renwu District,Kaohsiung City

 +886-7-375-3111

 +886-7-373-9796

泰國工廠 THAILAND FACTORY


泰國羅勇 Rayong,Thailand


 +66-3-865-0598~600

 +66-3-865-0596~597

越南工廠 VIETNAM FACTORY

胡志明市 Ho Chi Minh City,Vietnam

 +84-8-3796-8078~9

 +84-8-3796-8077

發行日期 Date of issue : 2021/05

本公司保留一切更改權利，恕不另行通知。
We reserve all the right to change, without notice.

內容資料及圖片嚴禁轉載。
Reproduction of all contents and images are strictly prohibited